


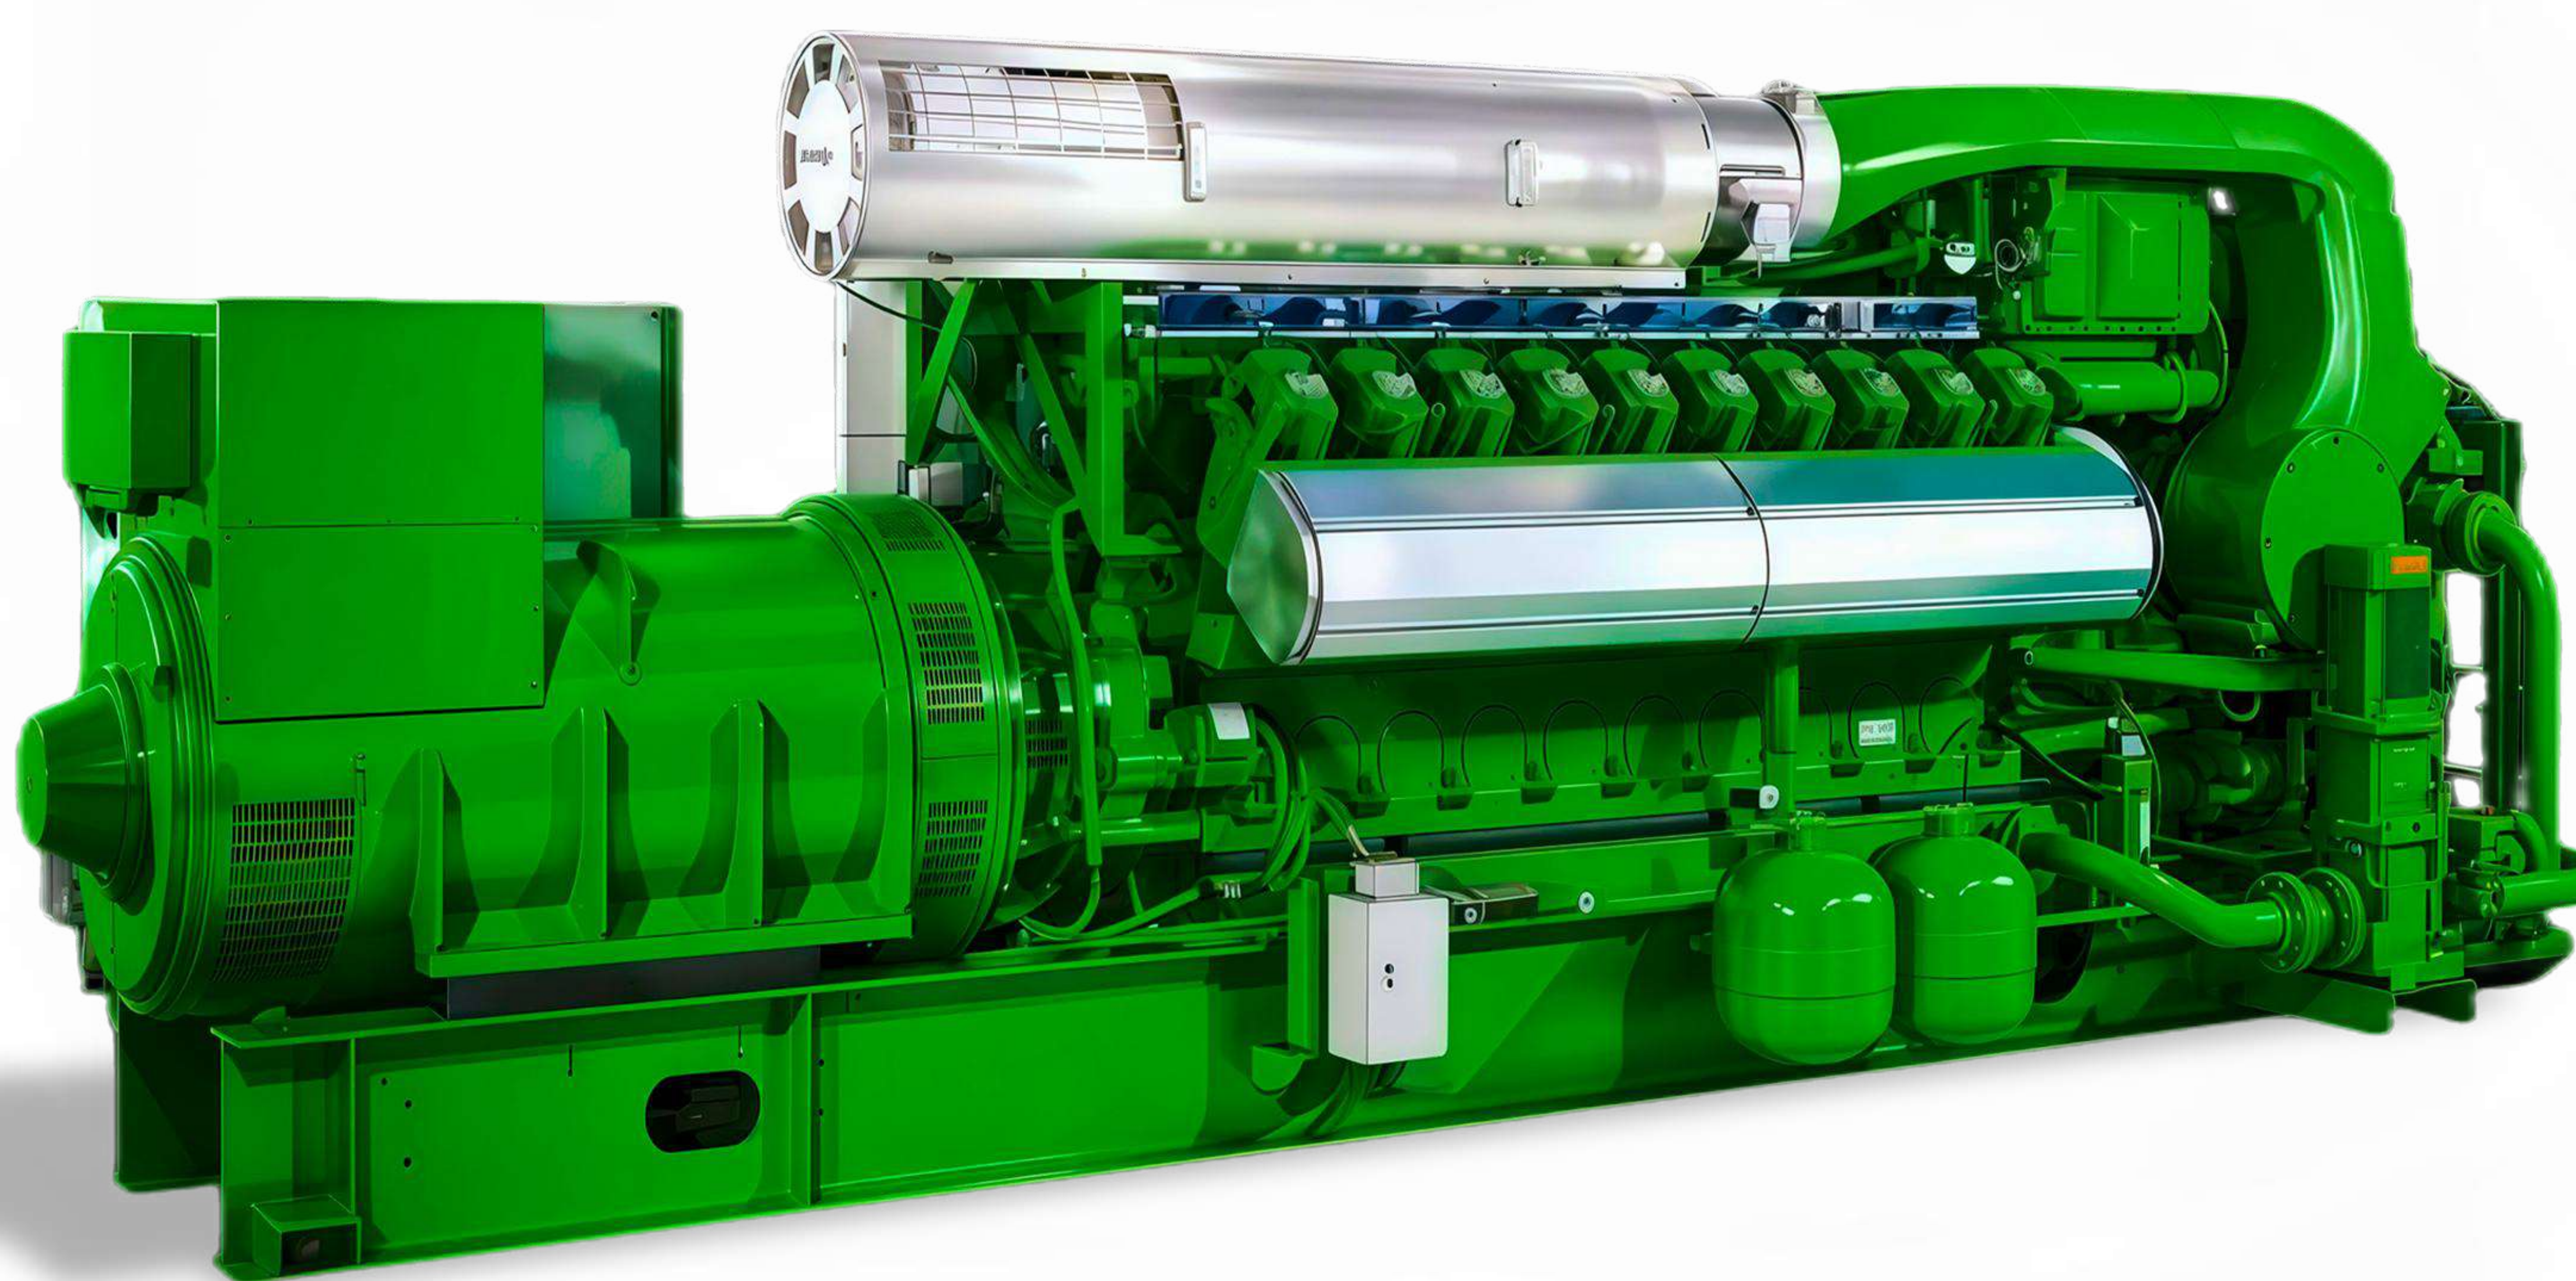

0.01 Technical Data (at module)

			100%	75%	50%
Power input	[2]	kW	3.539	2.727	1.914
Gas volume	*)	Nm³/h	786	606	425
Mechanical output	[1]	kW	1.540	1.155	770
Electrical output	[4]	kW el.	1.498	1.123	745
Recoverable thermal output (calculated with Glykol 37%)					
~ Intercooler 1st stage	[9]	kW	385	201	56
~ Lube oil		kW	208	184	170
~ Jacket water		kW	359	330	272
~ Exhaust gas cooled to 180 °C		kW	568	476	369
Total recoverable thermal output	[5]	kW	1.520	1.191	867
Total output generated		kW total	3.018	2.314	1.613
Heat to be dissipated (calculated with Glykol 37%)					
~ Intercooler 2nd stage		kW	72	60	51
~ Lube oil		kW	---	---	---
~ Surface heat	ca. [7]	kW	122	~	~
Spec. fuel consumption of engine electric	[2]	kWh/kWel.h	2,36	2,43	2,57
Spec. fuel consumption of engine	[2]	kWh/kWh	2,30	2,36	2,49
Lube oil consumption	ca. [3]	kg/h	0,31	~	~
Electrical efficiency			42,3%	41,2%	38,9%
Thermal efficiency			42,9%	43,7%	45,3%
Total efficiency	[6]		85,3%	84,9%	84,3%
Hot water circuit:					
Forward temperature		°C	95,0	90,5	86,0
Return temperature		°C	74,0	74,0	74,0
Hot water flow rate		m³/h	69,7	69,7	69,7
Fuel gas LHV		kWh/Nm³	4,5		

*) approximate value for pipework dimensioning
[] Explanations: see 0.10 - Technical parameters

All heat data is based on standard conditions according to attachment 0.10. Deviations from the standard conditions can result in a change of values within the heat balance and must be taken into consideration in the layout of the cooling circuit/equipment (intercooler; emergency cooling; ...). In the specifications in addition to the general tolerance of ±8 % on the thermal output a further reserve of +5 % is recommended for the dimensioning of the cooling requirements.

Main dimensions and weights (at module)

Length	mm	~ 7.100
Width	mm	~ 1.800
Height	mm	~ 2.200
Weight empty	kg	~ 17.000
Weight filled	kg	~ 17.700

Connections

Hot water inlet and outlet [A/B]	DN/PN	100/10
Exhaust gas outlet [C]	DN/PN	300/10
Fuel Gas (at module) [D]	DN/PN	125/16
Water drain ISO 228	G	1/2"
Condensate drain	DN/PN	50/10
Safety valve - jacket water ISO 228 [G]	DN/PN	2x1 1/2"/2,5
Safety valve - hot water	DN/PN	65/16
Lube oil replenishing (pipe) [I]	mm	28
Lube oil drain (pipe) [J]	mm	28
Jacket water - filling (flex pipe) [L]	mm	13
Intercooler water-Inlet/Outlet 1st stage	DN/PN	100/10
Intercooler water-Inlet/Outlet 2nd stage [M/N]	DN/PN	65/10

Output / fuel consumption

ISO standard fuel stop power ICFN	kW	1.540
Mean effe. press. at stand. power and nom. speed	bar	20,17
Fuel gas type		Biogas
Based on methane number Min. methane number	MZ	135 117 d)
Compression ratio	Epsilon	12,5
Min./Max. fuel gas pressure at inlet to gas train	mbar	120 - 200 c)
Max. rate of gas pressure fluctuation	mbar/sec	10
Maximum Intercooler 2nd stage inlet water temperature	°C	55
Spec. fuel consumption of engine	kWh/kWh	2,30
Specific lube oil consumption	g/kWh	0,20
Max. Oil temperature	°C	85
Jacket-water temperature max.	°C	95
Filling capacity lube oil (refill)	lit	~ 437

c) Lower gas pressures upon inquiry

d) based on methane number calculation software AVL 3.2

0.02 Technical data of engine

Manufacturer		JENBACHER
Engine type		J 420 GS-B25
Working principle		4-Stroke
Configuration		V 70°
No. of cylinders		20
Bore	mm	145
Stroke	mm	185
Piston displacement	lit	61,10
Nominal speed	rpm	1.500
Mean piston speed	m/s	9,25
Length	mm	3.750
Width	mm	1.580
Height	mm	2.033
Weight dry	kg	7.200
Weight filled	kg	7.900
Moment of inertia	kgm ²	11,64
Direction of rotation (from flywheel view)		left
Radio interference level to VDE 0875		N
Starter motor output	kW	13
Starter motor voltage	V	24

Thermal energy balance

Power input	kW	3.539
Intercooler	kW	457
Lube oil	kW	208
Jacket water	kW	359
Exhaust gas cooled to 180 °C	kW	568
Exhaust gas cooled to 100 °C	kW	758
Surface heat	kW	64

Exhaust gas data

Exhaust gas temperature at full load	[8]	°C	410
Exhaust gas temperature at bmep= 15,1 [bar]		°C	~ 432
Exhaust gas temperature at bmep= 10,1 [bar]		°C	~ 462
Exhaust gas mass flow rate, wet		kg/h	7.947
Exhaust gas mass flow rate, dry		kg/h	7.395
Exhaust gas volume, wet		Nm ³ /h	6.207
Exhaust gas volume, dry		Nm ³ /h	5.519
Max.admissible exhaust back pressure after engine		mbar	60

Combustion air data

Combustion air mass flow rate	kg/h	7.338
Combustion air volume	Nm ³ /h	5.678
Max. admissible pressure drop at air-intake filter	mbar	10

basis for exhaust gas data: natural gas: 100% CH₄; biogas 65% CH₄, 35% CO₂

Sound pressure level

Aggregate a)			dB(A) re 20μPa	99		
31,5	Hz		dB		79	
63	Hz		dB		87	
125	Hz		dB		98	
250	Hz		dB		95	
500	Hz		dB		96	
1000	Hz		dB		91	
2000	Hz		dB		90	
4000	Hz		dB		92	
8000	Hz		dB		89	
Exhaust gas b)			dB(A) re 20μPa	115		
31,5	Hz		dB		95	
63	Hz		dB		117	
125	Hz		dB		115	
250	Hz		dB		113	
500	Hz		dB		108	
1000	Hz		dB		105	
2000	Hz		dB		108	
4000	Hz		dB		109	
8000	Hz		dB		107	

Sound power level

Aggregate	dB(A) re 1pW	119
Measurement surface	m²	110
Exhaust gas	dB(A) re 1pW	123
Measurement surface	m²	6,28

a) average sound pressure level on measurement surface in a distance of 1m (converted to free field) according to DIN 45635, precision class 3.

b) average sound pressure level on measurement surface in a distance of 1m according to DIN 45635, precision class 2.

The spectra are valid for aggregates up to bmep=19 bar. (for higher bmep add safety margin of 1dB to all values per increase of 1 bar pressure).

Engine tolerance ± 3 dB

0.03 Technical data of generator

Manufacturer		Leroy-Somer(-0,925cap) e)
Type		LSA 52.3 L9 e)
Type rating	kVA	1.870
Driving power	kW	1.540
Ratings at p.f. = 1,0	kW	1.498
Ratings at p.f. = 0,8	kW	1.482
Rated output at p.f. = 0,8	kVA	1.852
Rated reactive power at p.f. = 0,8	kVar	1.111
Rated current at p.f. = 0,8	A	2.673
Frequency	Hz	50
Voltage	V	400
Speed	rpm	1.500
Permissible overspeed	rpm	1.800
Power factor (lagging - leading) (UN)		0,8 - 0,95
Efficiency at p.f. = 1,0		97,3%
Efficiency at p.f. = 0,8		96,2%
Moment of inertia	kgm ²	48,30
Mass	kg	4.489
Radio interference level to EN 55011 Class A (EN 61000-6-4)		N
Cable outlet		left
I _k " Initial symmetrical short-circuit current	kA	24,94
I _s Peak current	kA	63,49
Insulation class		H
Temperature (rise at driving power)		F
Maximum ambient temperature	°C	40

Reactance and time constants (saturated) at rated output

x _d direct axis synchronous reactance	p.u.	2,034
x _d ' direct axis transient reactance	p.u.	0,205
x _d " direct axis sub transient reactance	p.u.	0,106
x ₂ negative sequence reactance	p.u.	0,107
T _d " sub transient reactance time constant	ms	10
T _a Time constant direct-current	ms	20
T _{do} ' open circuit field time constant	s	1,92

e) JENBACHER reserves the right to change the generator supplier and the generator type. The contractual data of the generator may thereby change slightly. The contractual produced electrical power will not change.

0.04 Technical data of heat recovery

General data - Hot water circuit

Total recoverable thermal output	kW	1.520
Return temperature	°C	74,0
Forward temperature	°C	95,0
Hot water flow rate	m³/h	69,7
Nominal pressure of hot water	PN	10
min. operating pressure	bar	3,5
max. operating pressure	bar	9,0
Pressure drop hot water circuit	bar	1,20
Maximum Variation in return temperature	°C	+0/-5
Max. rate of return temperature fluctuation	°C/min	10

General data - Cooling water circuit

Heat to be dissipated (calculated with Glykol 37%)	kW	72
Return temperature	°C	55
Cooling water flow rate	m³/h	20
Nominal pressure of cooling water	PN	10
min. operating pressure	bar	0,5
max. operating pressure	bar	5,0
Loss of nominal pressure of cooling water	bar	~
Maximum Variation in return temperature	°C	+0/-5
Max. rate of return temperature fluctuation	°C/min	10

Exhaust gas heat exchanger

Type	shell-and-tube
------	----------------

PRIMARY:

Exhaust gas pressure drop approx	bar	0,02
Exhaust gas connection	DN/PN	300/10

SECONDARY:

Pressure drop hot water circuit	bar	0,20
Hot water connection	DN/PN	100/10

The final pressure drop will be given after final order clarification and must be taken from the P&ID order documentation.

Hot water circuit (calculated with Glykol 37%)


connection variant F

J 420 GS-B25

Recoverable thermal output = 1.520 kW

(±8 % tolerance +5 % reserve for cooling requirements)

Hot water flow rate = 69,7 m³/h

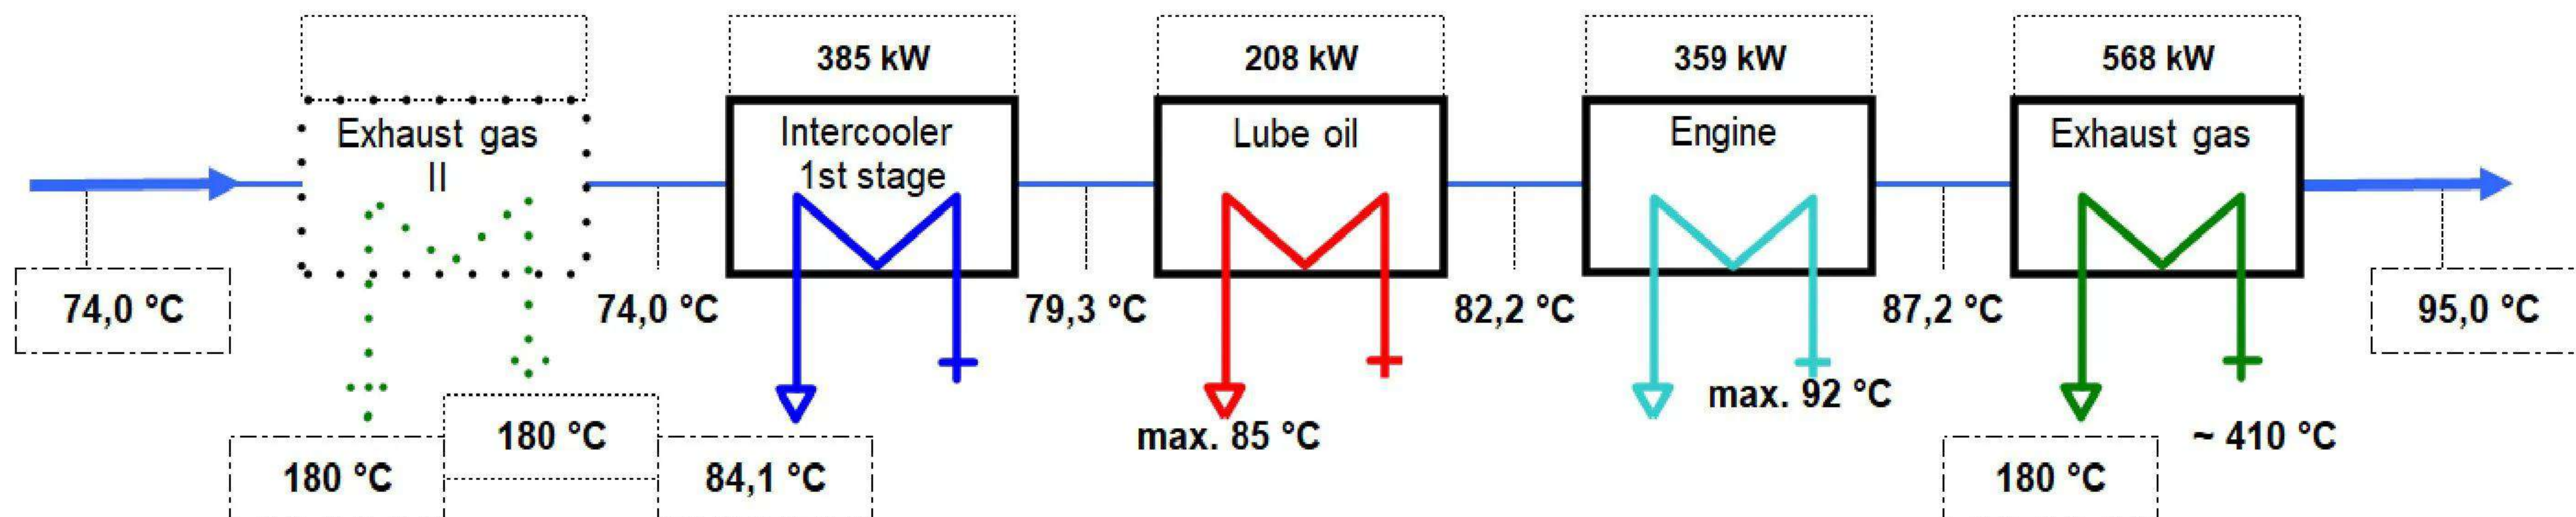


Low temperature circuit (calculated with Glykol 37%)

Heat to be dissipated = 72 kW

(±8 % tolerance +5 % reserve for cooling requirements)

Cooling water flow rate = 20,0 m³/h

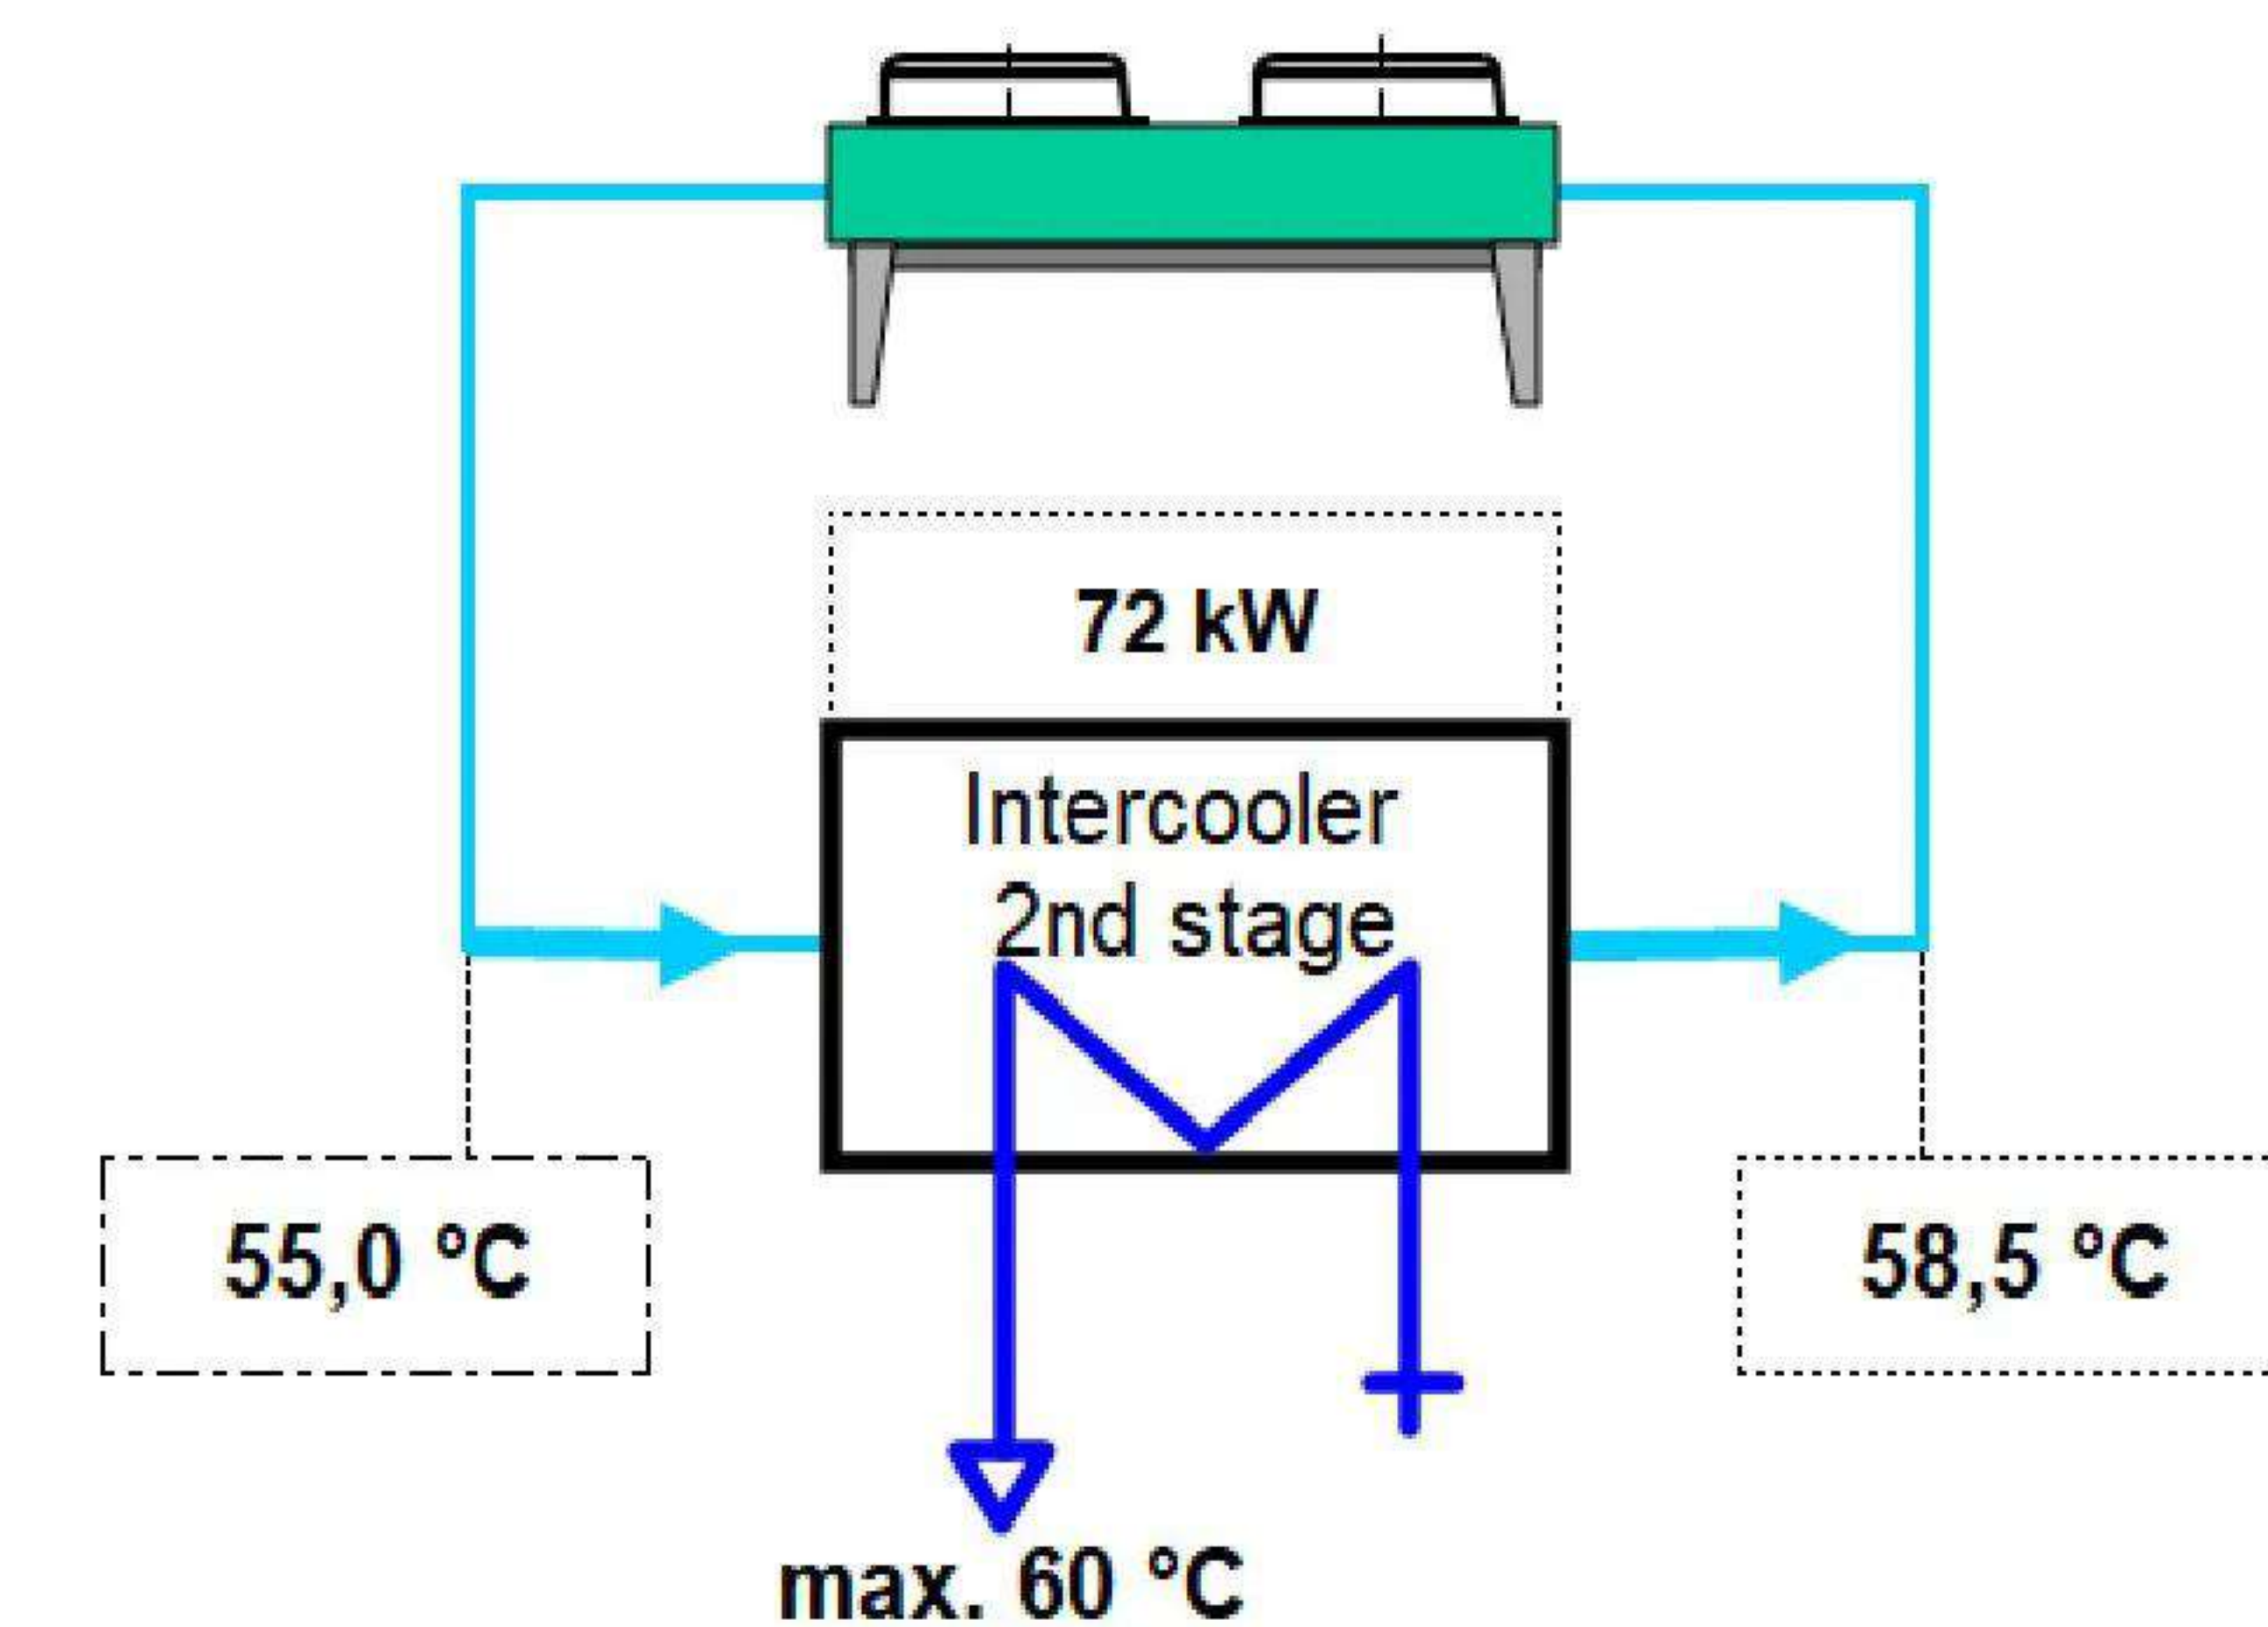

0.10 Technical parameters

All data in the technical specification are based on engine full load (unless stated otherwise) at specified temperatures and the methane number and subject to technical development and modifications.

All pressure indications are to be measured and read with pressure gauges (psi.g.).

[1] At nominal speed and standard reference conditions ICFN according to ISO 3046-1, respectively

[2] According to ISO 3046-1, respectively, with a tolerance of **+5 %**.

Efficiency performance is based on a new unit (immediately upon commissioning). Effects of degradation during normal operation can be mitigated through regular service and maintenance work.

reference value --> 65%CH₄ / 35%CO₂

[3] Average value between oil change intervals according to maintenance schedule, without oil change amount

[4] At p. f. = 1.0 according to VDE 0530 REM / IEC 34.1 with relative tolerances, all direct driven pumps are included

[5] Total output with a tolerance of $\pm 8 \%$

[6] According to above parameters [1] through [5]

[7] As a guiding value at p.f. 0.8 and only valid for (engine, generator, TCM). Other peripheral equipment is not considered.

[8] Exhaust temperature with a tolerance of $\pm 8 \%$

[9] Intercooler heat on:

* **standard conditions** - If the turbocharger design is done for air intake temperature $> 30^{\circ}\text{C}$ w/o de-rating, the intercooler heat of the 1st stage need to be increased by $2^{\circ}/^{\circ}\text{C}$ starting from 25°C .

Deviations between $25 - 30^{\circ}\text{C}$ will be covered with the standard tolerance.

* **Hot Country application (V1xx)** - If the turbocharger design is done for air intake temperature $> 40^{\circ}\text{C}$ w/o de-rating, the intercooler heat of the 1st stage need to be increased by $2^{\circ}/^{\circ}\text{C}$ starting from 35°C . Deviations between $35 - 40^{\circ}\text{C}$ will be covered with the standard tolerance.

Radio interference level

The ignition system of the gas engines complies the radio interference levels of CISPR 12 and EN 55011 class B, (30-75 MHz, 75-400 MHz, 400-1000 MHz) and (30-230 MHz, 230-1000 MHz), respectively.

Definition of output

- ISO-ICFN continuous rated power:

Net break power that the engine manufacturer declares an engine is capable of delivering continuously, at stated speed, between the normal maintenance intervals and overhauls as required by the manufacturer. Power determined under the operating conditions of the manufacturer's test bench and adjusted to the standard reference conditions.

- Standard reference conditions:

Barometric pressure: 1000 mbar (14.5 psi) or 100 m (328 ft) above sea level

Air temperature: 25°C (77°F) or 298 K

Relative humidity: 30 %

- Volume values at standard conditions (fuel gas, combustion air, exhaust gas)

Pressure: 1013 mbar (14.7 psi)

Temperature: 0°C (32°F) or 273 K

Loss of engine performance

a) Performance reduction due to gas quality

If the reference methane number is not reached and the knock control responds, the ignition timing at full performance is adjusted in conjunction with the engine management system; only then is performance reduced.

H₂ admixtures in the range of 3–5 Vol% into the natural gas network are generally regarded as non-critical. Prerequisites for this are rates of change according to TA 1000-0300, as well as the knock resistance (minimum methane number) of the natural gas-H₂ mixture according to the specification. For reliable compliance with required NO_x emissions, the JENBACHER LEANOX^{plus} control is recommended (measurement of NO_x emissions and correction of the LEANOX controller). Higher H₂ addition rates into the natural gas network must be assessed on a project-specific basis.


b) Performance reduction due to voltage and frequency limits

If the voltage and frequency limits for generators specified in IEC 60034-1 Zone A are exceeded, performance is reduced.

c) Performance reduction due to environmental conditions

Standard rating of the engines is for an installation at an altitude ≤ 500 m and combustion air temperature ≤ 30 °C (T₁)

Engine room outlet temperature: 50°C (T₂) -> engine stop

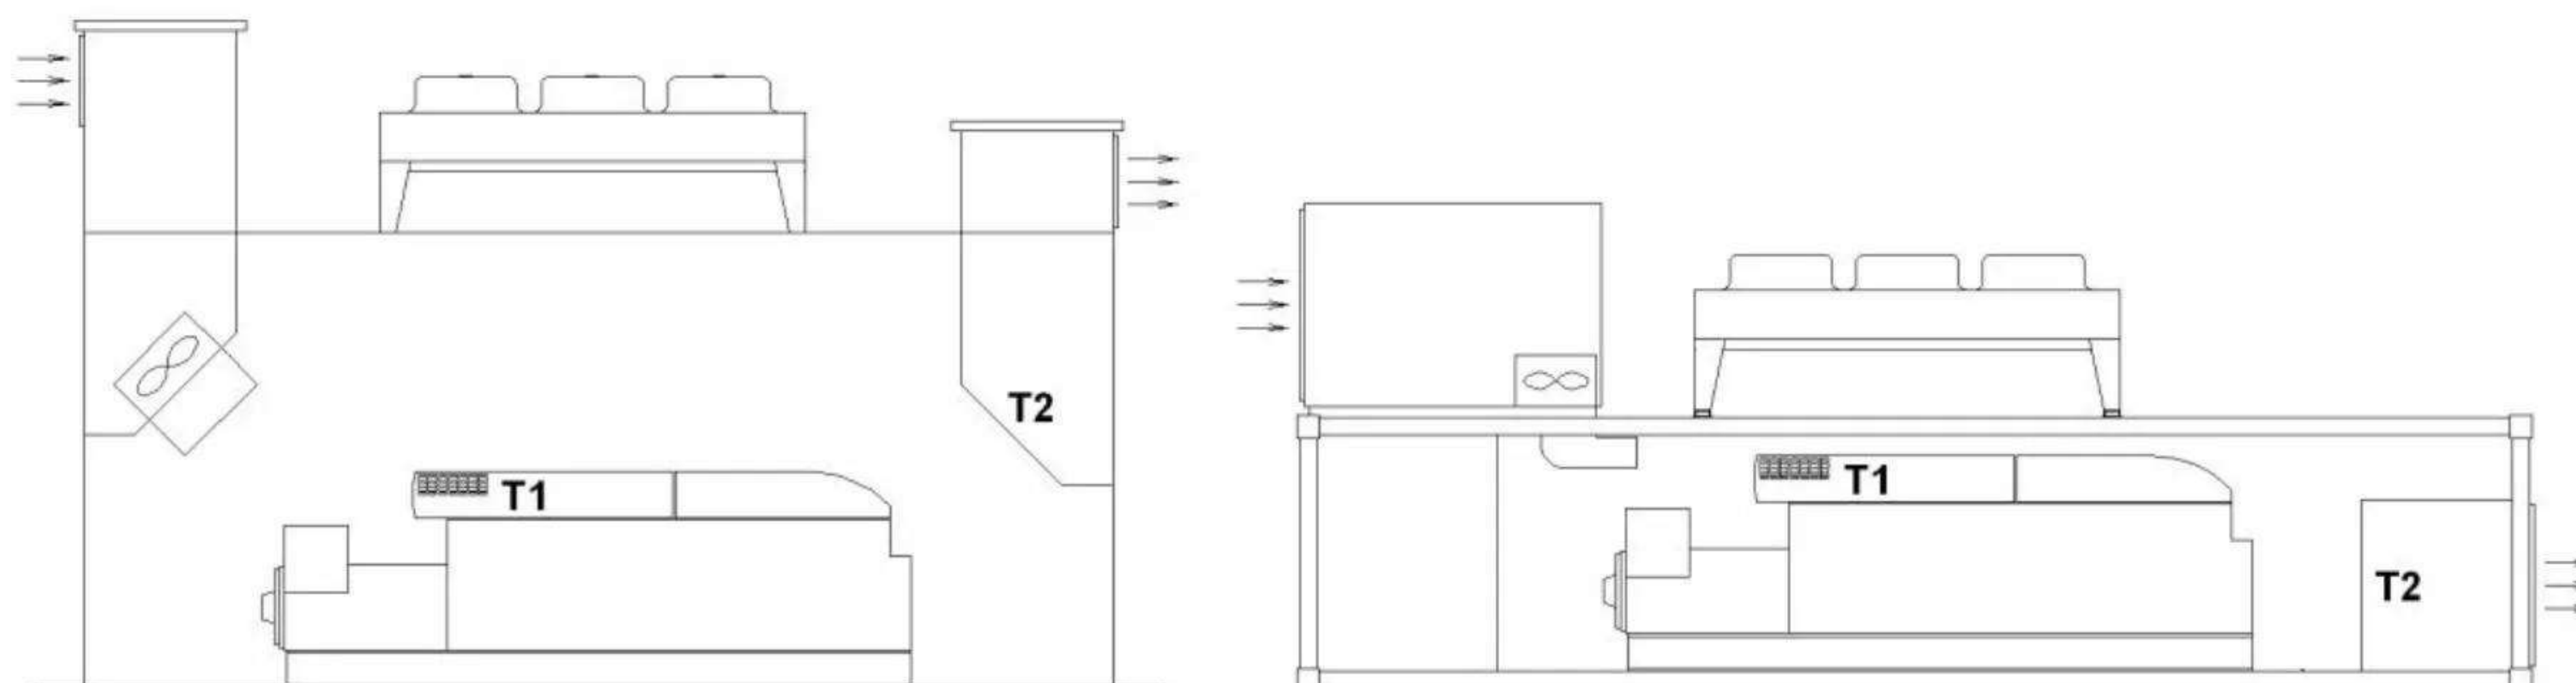

The minimum recommended air change ratio (C) must be observed to maintain the required air quality and prevent unwanted gas accumulations (refer to Section ⇒ Potentially explosive Atmospheres as per TA1100-0110). The calculation is based on TA 1100-0110 and is $C_{min} = 50h^{-1}$ for JENBACHER modules.

Parameters for the operation of JENBACHER gas engines

The genset fulfils the limits for mechanical vibrations according to ISO 8528-9.

The following forms an integral part of a contract and must be strictly observed: **TA 1000-0004, TA 1100 0110, TA 1100-0111, and TA 1100-0112.**

Transport by rail should be avoided. See **TA 1000-0046** for further details

Failure to adhere to the requirements of the above-mentioned TA documents can lead to engine damage and may result in loss of warranty coverage.

Parameters for the operation of control unit and the electrical equipment

Relative humidity 50% by maximum temperature of 40°C.

Altitude up to 2000m above the sea level.

Parameters for using a gas compressor

The gas quantity indicated under the technical data refers to standard conditions with the given calorific value. The actual volume flow (under operating conditions) has to be considered for dimensioning the gas compressor and each gas feeding component – it will be affected by:

- Actual gas temperature (limiting temperature according to **TA 1000-0300**)
- Gas humidity (limiting value according to **TA 1000-0300**)
- Gas Pressure
- Calorific value variations (can be equated with methane (CH₄) variations in the case of biogas)
- The gas compressor is designed for a max. relative under pressure of 15 mbar(g) (0.22 psi) and a inlet temperature of 40°C (104°F) , if within scope of supply JENBACHER.

0.20 Mode of Operation

Grid Parallel Mode

The genset is running in parallel to the utility. The unit load can be adjusted via its power control set point or designated option.

Procedure in the event of mains failure:

When the mains monitor relay (protective relay ANSI No. 27, 59, 81, 78- provided either by JENBACHER or the customer) is activated due to a mains failure, the engine is isolated from the mains by opening the generator breaker. The module is shut down without any cool-down run.

Island operation is not available in this case!

The module can be restarted following the restoration of mains power after a 5-minute mains stabilization period.